

* - INDICATES COMPONENTS NOT SUPPLIED BY YASKAWA.
 --- INDICATES CUSTOMER WIRING.
 SEE DRAWING UDE00391 FOR CUSTOMER CONNECTION TABLES.
 SEE DRAWING UDE00392 FOR DRIVE PARAMETER SETTINGS.


- NOTES:
- CONNECTED TO THE CABINET. CUSTOMER TO CONNECT THE CABINET GROUND LUGS TO EARTH GROUND AND UTILITY GROUND.
 - CONDUIT FITTINGS/HUBS SHALL COMPLY WITH THE 'STANDARD FOR CONDUIT, TUBING, AND CABLE FITTINGS, UL 514B' OR CONDUIT FITTINGS HAVING THE SAME ENVIRONMENTAL RATING AS THE ENCLOSURE SHALL BE USED.
 - WITHOUT THE CIRCUIT BREAKER (OPTION PC OR PE), OR DISCONNECT SWITCH OPTION PD, THE DISCONNECT MEANS MUST BE SUPPLIED BY THE CUSTOMER.
 - BRANCH CIRCUIT PROTECTION TO BE SUPPLIED BY THE CUSTOMER WHEN NOTED ON THE CABINET DATA NAMEPLATE.
 - INSULATED TWISTED SHIELDED WIRE IS REQUIRED. SHIELD TO CONNECT TO PROPER TERMINALS AS SHOWN. CONNECT THE SHIELD ONLY AT THIS END. STUB AND ISOLATE THE OTHER END. DO NOT RUN THESE WIRES IN THE SAME CONDUIT AS THE AC POWER AND AC CONTROL WIRES. KEEP ALL WIRING UNDER 50m IN LENGTH.
 - CUSTOMER TO ADJUST THE THERMOSTAT ON THE SPACE HEATER HR1 FOR THE MINIMUM DESIRED TEMPERATURE INSIDE THE DRIVE CABINET. THIS SET TEMPERATURE IS NORMALLY SELECTED TO BE SLIGHTLY HIGHER THAN THE MINIMUM AMBIENT TEMPERATURE OF THE AIR SURROUNDING THE CABINET, AND IS THE TEMPERATURE AT WHICH THE SPACE HEATER HR1 WILL SHUT OFF.
 - FOR A CONTROL TRANSFORMER T1 POWER RATING OF 350VA OR GREATER, SECONDARY FUSE F6 IS ADDED.
 - IF AC MOTOR IS FURNISHED WITH A N.C. THERMAL SWITCH THEN SET DRIVE PARAMETER H1-08 TO 27. THIS WILL CAUSE THE DRIVE TO COAST TO STOP UPON AN AC MOTOR THERMAL FAULT. ALONG WITH THIS, ADD THE FOLLOWING CUSTOMER WIRING: WIRE THE N.C. THERMAL SWITCH BETWEEN TERMINAL S8 OF THE 120VAC SOURCE.
 - OPTIONS TD, TG, TH, TJ, TL, TQ OR TU CONTROL (SEE UDE00392 FOR MORE INFORMATION)
 - CUSTOMER TO REPLACE THE JUMPER WITH NORMALLY CLOSED SAFETY INTERLOCKS, IF APPLICABLE.
 - CUSTOMER MUST PROVIDE PROPER SHORT CIRCUIT PROTECTION AND MEANS OF DISCONNECT.

REVISIONS			
REV.	DESCRIPTION	ECO #	DRAWN BY DATE
10	UPDATE WIRE LABELS ON Q1C3 WITH VMR	14055	JZ 08/29/24
09	ADD S3 AND S4 TERMINAL LABELS	10630	KG 06/09/20
08	ADD OPTION P9 SURGE SUPPRESSOR	8264	RCR 01/08/18

YASKAWA		DRAWN BY: D.R. CMELAK	DATE: 11/16/12	TITLE: SCHEMATIC DIAGRAM IQPUMP1000 CONFIGURED TYPE 3R - F2 ENCL
		CHECKED: D. PACKER	DATE: 11/16/12	
		APPROVED: K. FLIERL	DATE: 11/16/12	SIZE: D REVISION: 10 PAGE: 1 of 3
		ORIGINAL DESIGN: D.R. CMELAK	DATE: 11/16/12	DRAWING #: DS.Q1C3R.07

201
202
203
204
205
206
207
208
209
210
211
212
213
214
215
216
217
218
219
220
221
222
223
224
225
226
227
228
229
230
231
232
233
234
235
236
237
238
239
240
241

CONTROL TRANSFORMER PRIMARY CONNECTIONS			
INPUT VOLTS	TERMINALS		JUMPER LOCATION
	A	B	
208	(H1)	(H2)	NONE
230/240	(H1)	(H4)	(H1) TO (H3) (H2) TO (H4)
460/480	(H1)	(H4)	(H2) TO (H3)
600	(H1)	(H2)	NONE

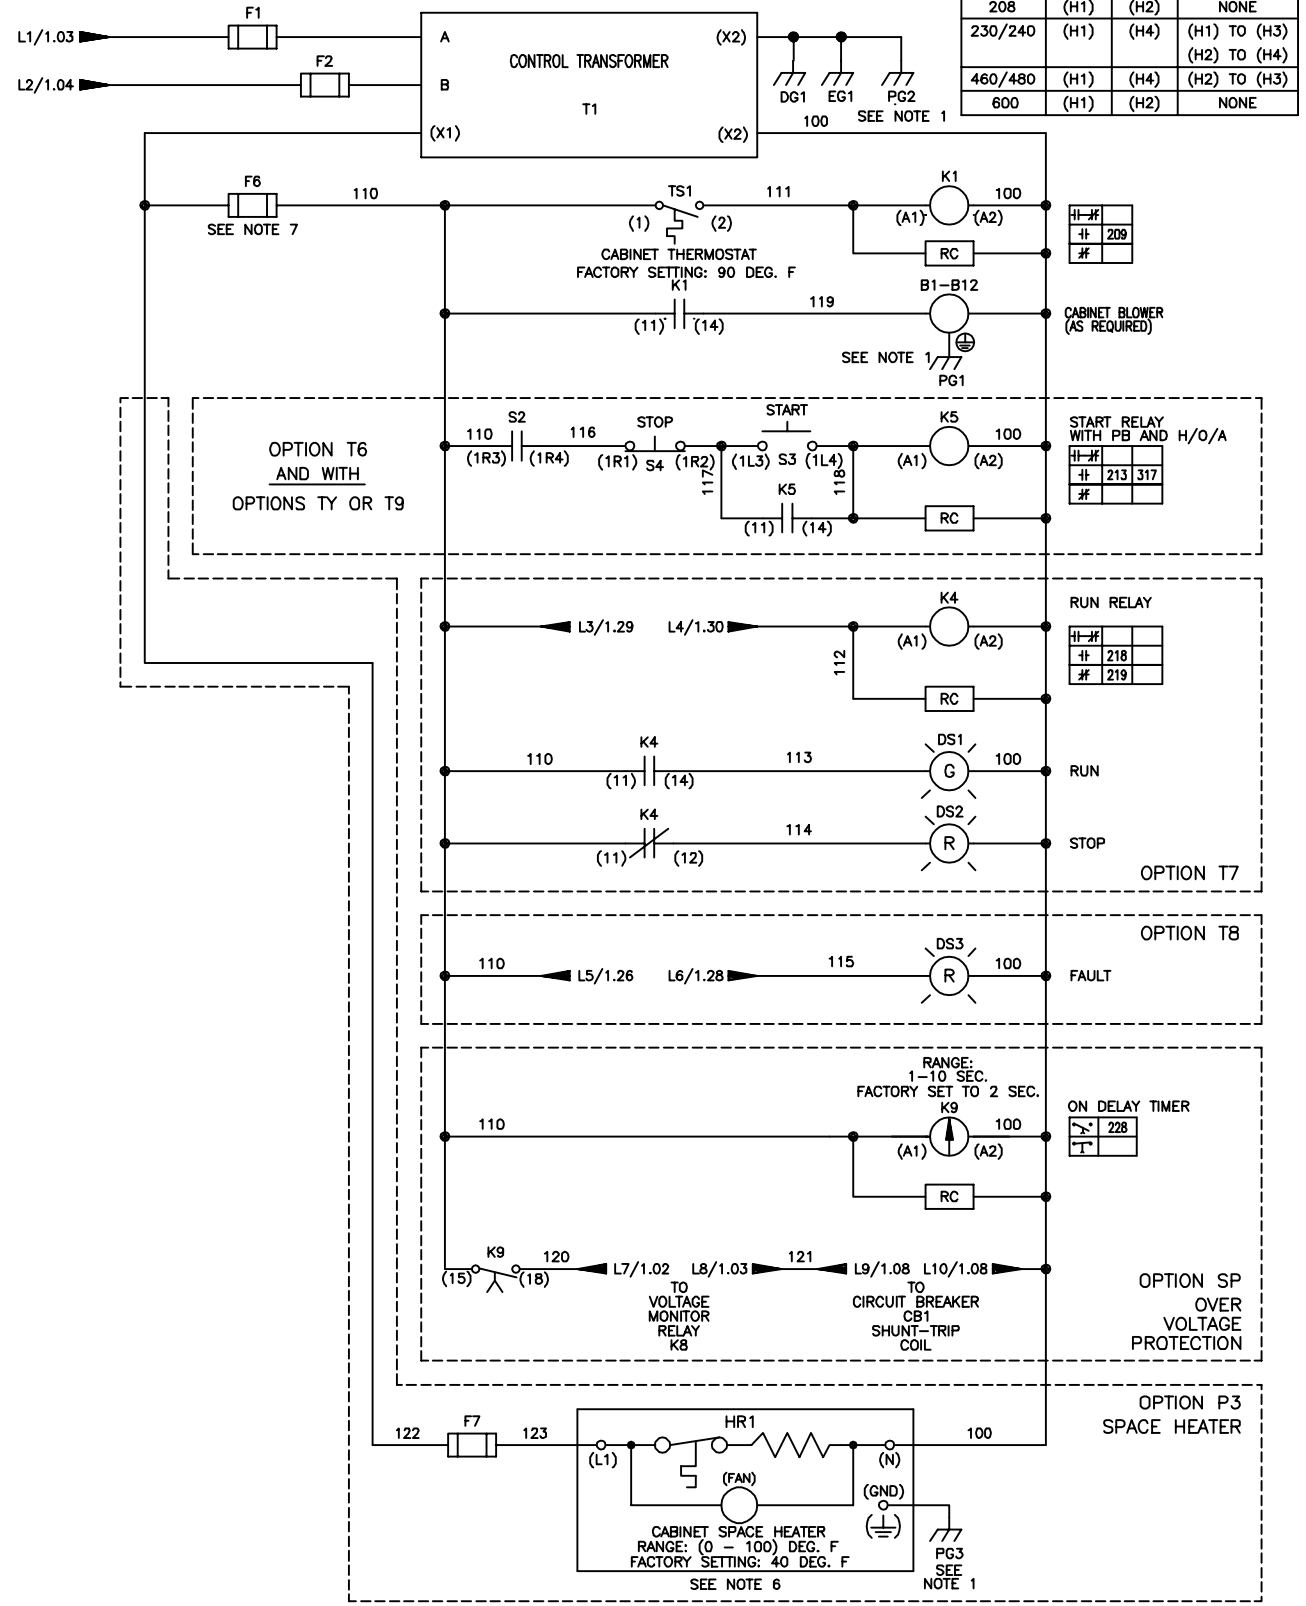


SEE SHEET 1 FOR NOTES.


YASKAWA <small>THIS DOCUMENT AND INFORMATION CONTAINED IN IT ARE CONFIDENTIAL, AND CANNOT BE COPIED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF YASKAWA AMERICA INC.</small>	DRAWN BY: D. R. CMELAK	DATE 11/16/12	TITLE SCHEMATIC DIAGRAM IQPUMP1000 CONFIGURED TYPE 3R - F2 ENCL
	CHECKED BY: D. PACKER	DATE 11/16/12	SIZE D
	APPROVED BY: K. FLIERL	DATE 11/16/12	REVISION 10
	ORIGINAL DESIGN: D. R. CMELAK	DATE 11/16/12	PAGE 2 of 3
			DRAWING# DS.Q1C3R.07

RUN/STOP CONTROL WITH OPTION TV (FROM SHEET 1)


301
302
303
304
305
306
307
308
309
310
311
312
313
314
315
316
317
318
319
320
321
322
323
324
325
326
327
328
329
330
331
332
333
334
335
336
337
338
339
340
341

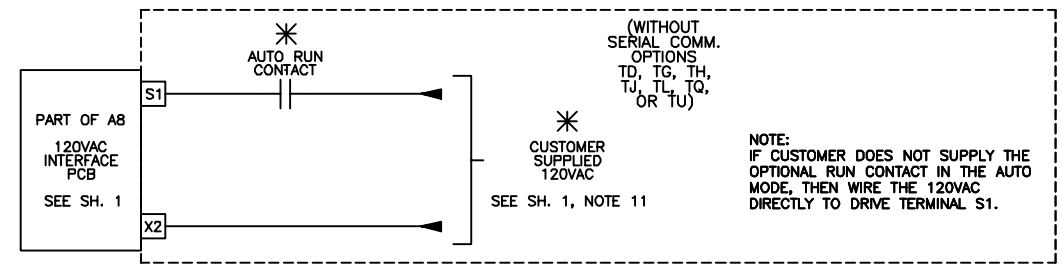


OR

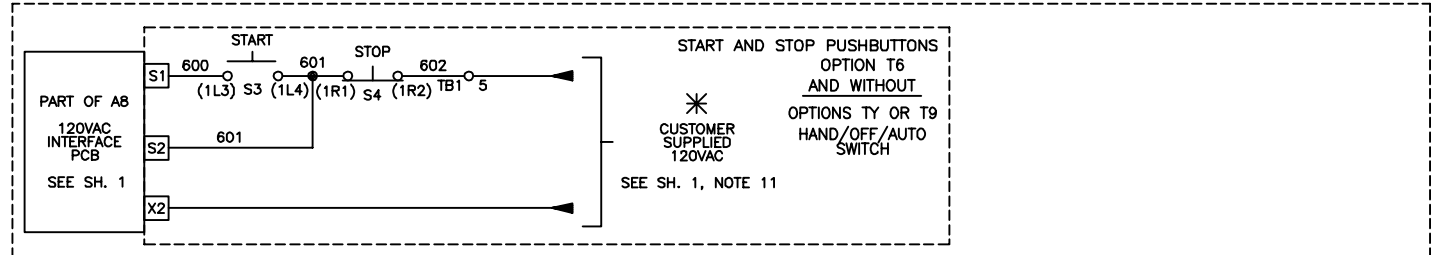



OR

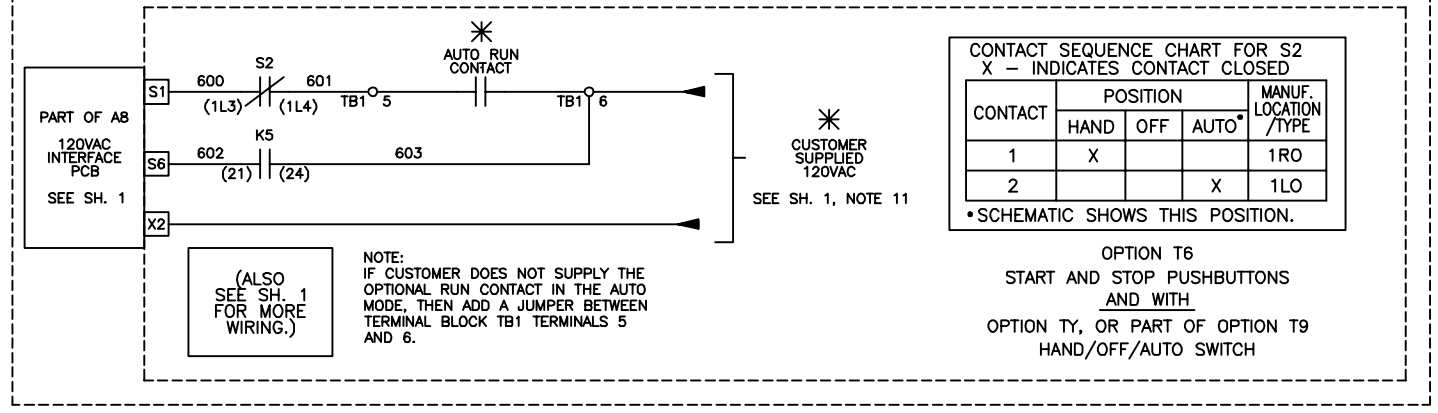

OR

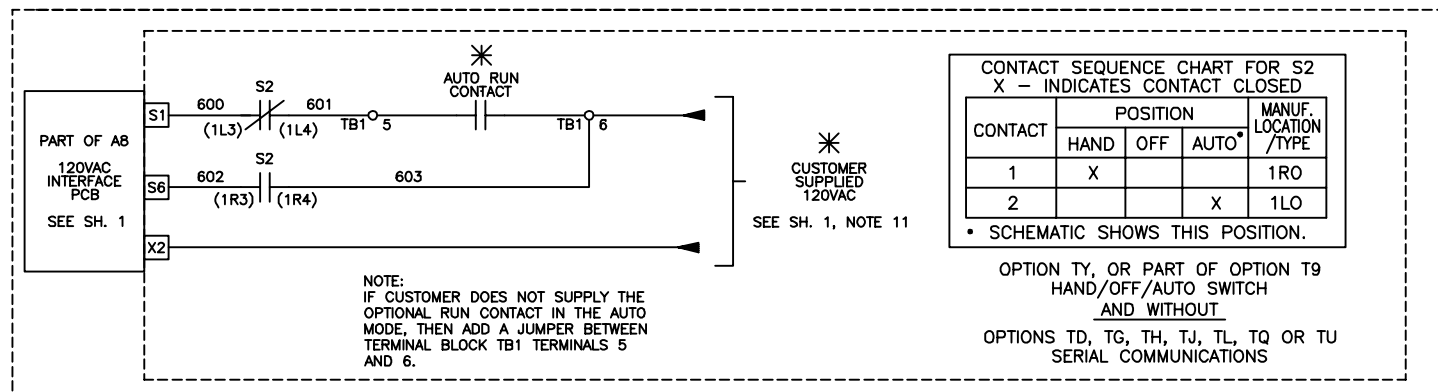

OR

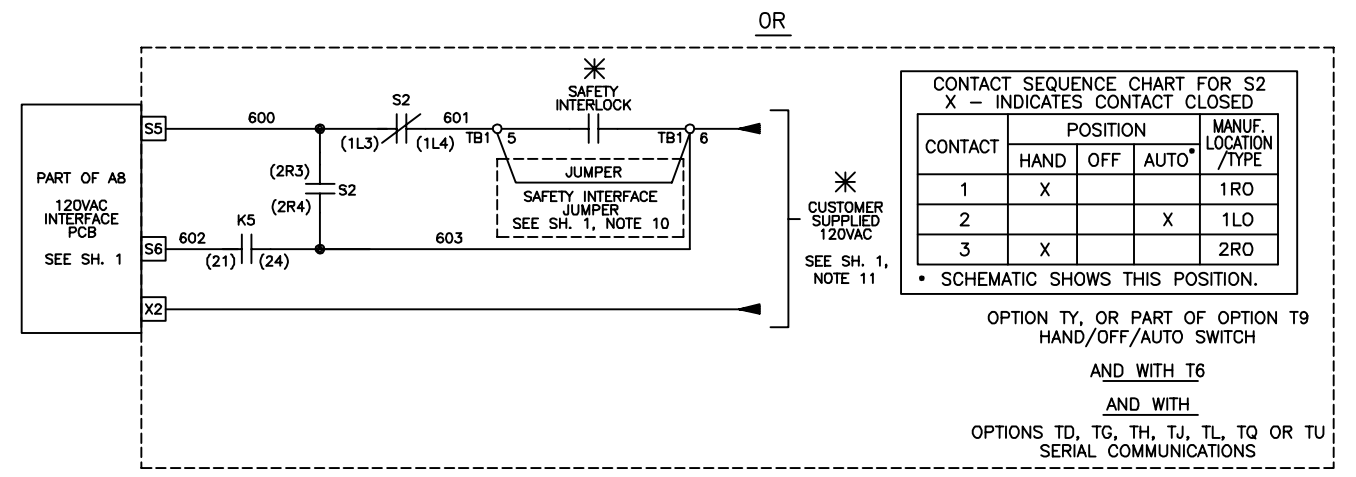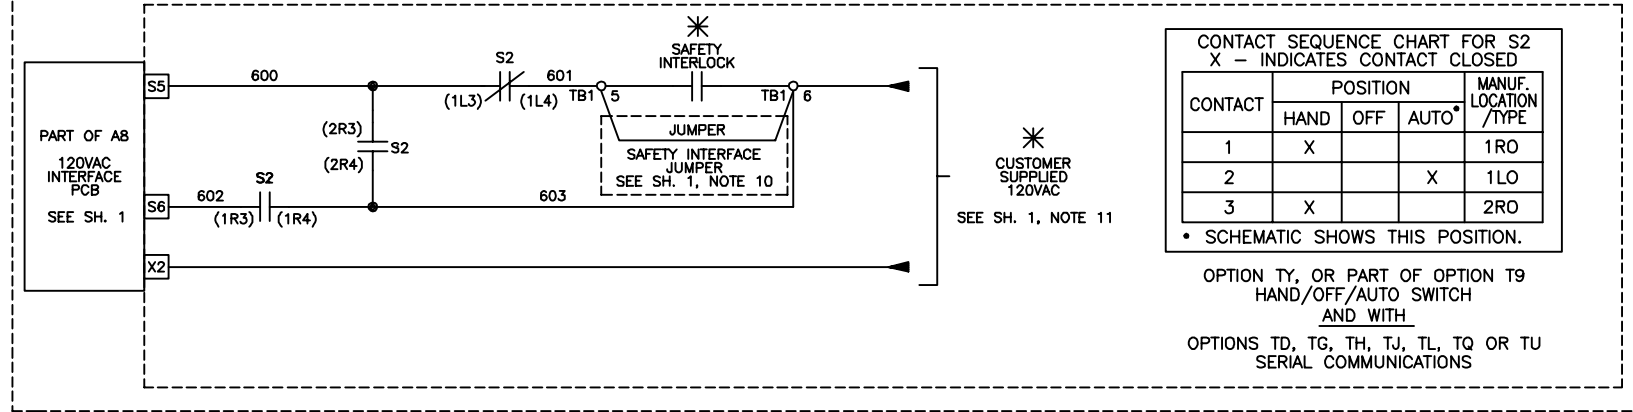

FOR ALL WIRE CONNECTION TO 120VAC INTERFACE PCB A8:
WIRE RANGE: (24 - 17) AWG.
WIRE TORQUE: (1.95 - 2.21) LB.-IN

SEE SHEET 1 FOR NOTES.

YASKAWA	DRAWN BY: D.R. CMELAK	DATE: 11/16/12	TITLE: SCHEMATIC DIAGRAM
	CHECKED: D. PACKER	DATE: 11/16/12	IQPUMP1000 CONFIGURED
TECH: _____		DATE: _____	TYPE 3R - F2 ENCL
APPROVED: K. FLIERL		DATE: 11/16/12	SIZE: D
ORIGINAL DESIGN: D.R. CMELAK		DATE: 11/16/12	REVISION: 10
			PAGE: 3 of 3
			DRAWING#: DS.Q1C3R.07